



DETAIL 'A'

IMPORTANT LEVELS TO NOTES:

COOL ROOM F.F.L.	: 18.70
COOL ROOM CEILING LEVEL (B.O.C.)	: 30.20
AHU ROOM 1 F.F.L.	: 30.40
AHU ROOM 2 F.F.L.	: 25.10
ALL DUCTS & PIPES LEVEL SHALL BE ABOVE (INCLUDING ALL NECESSARY SUPPORT BRACKETS)	: 28.70

LEGEND

⊙	REHEAT COIL
AHU	AIR HANDLING UNIT
CHWS	CHILLED WATER SUPPLY PIPE
CHWR	CHILLED WATER RETURN PIPE
R/A	RETURN AIR
S/A	SUPPLY AIR

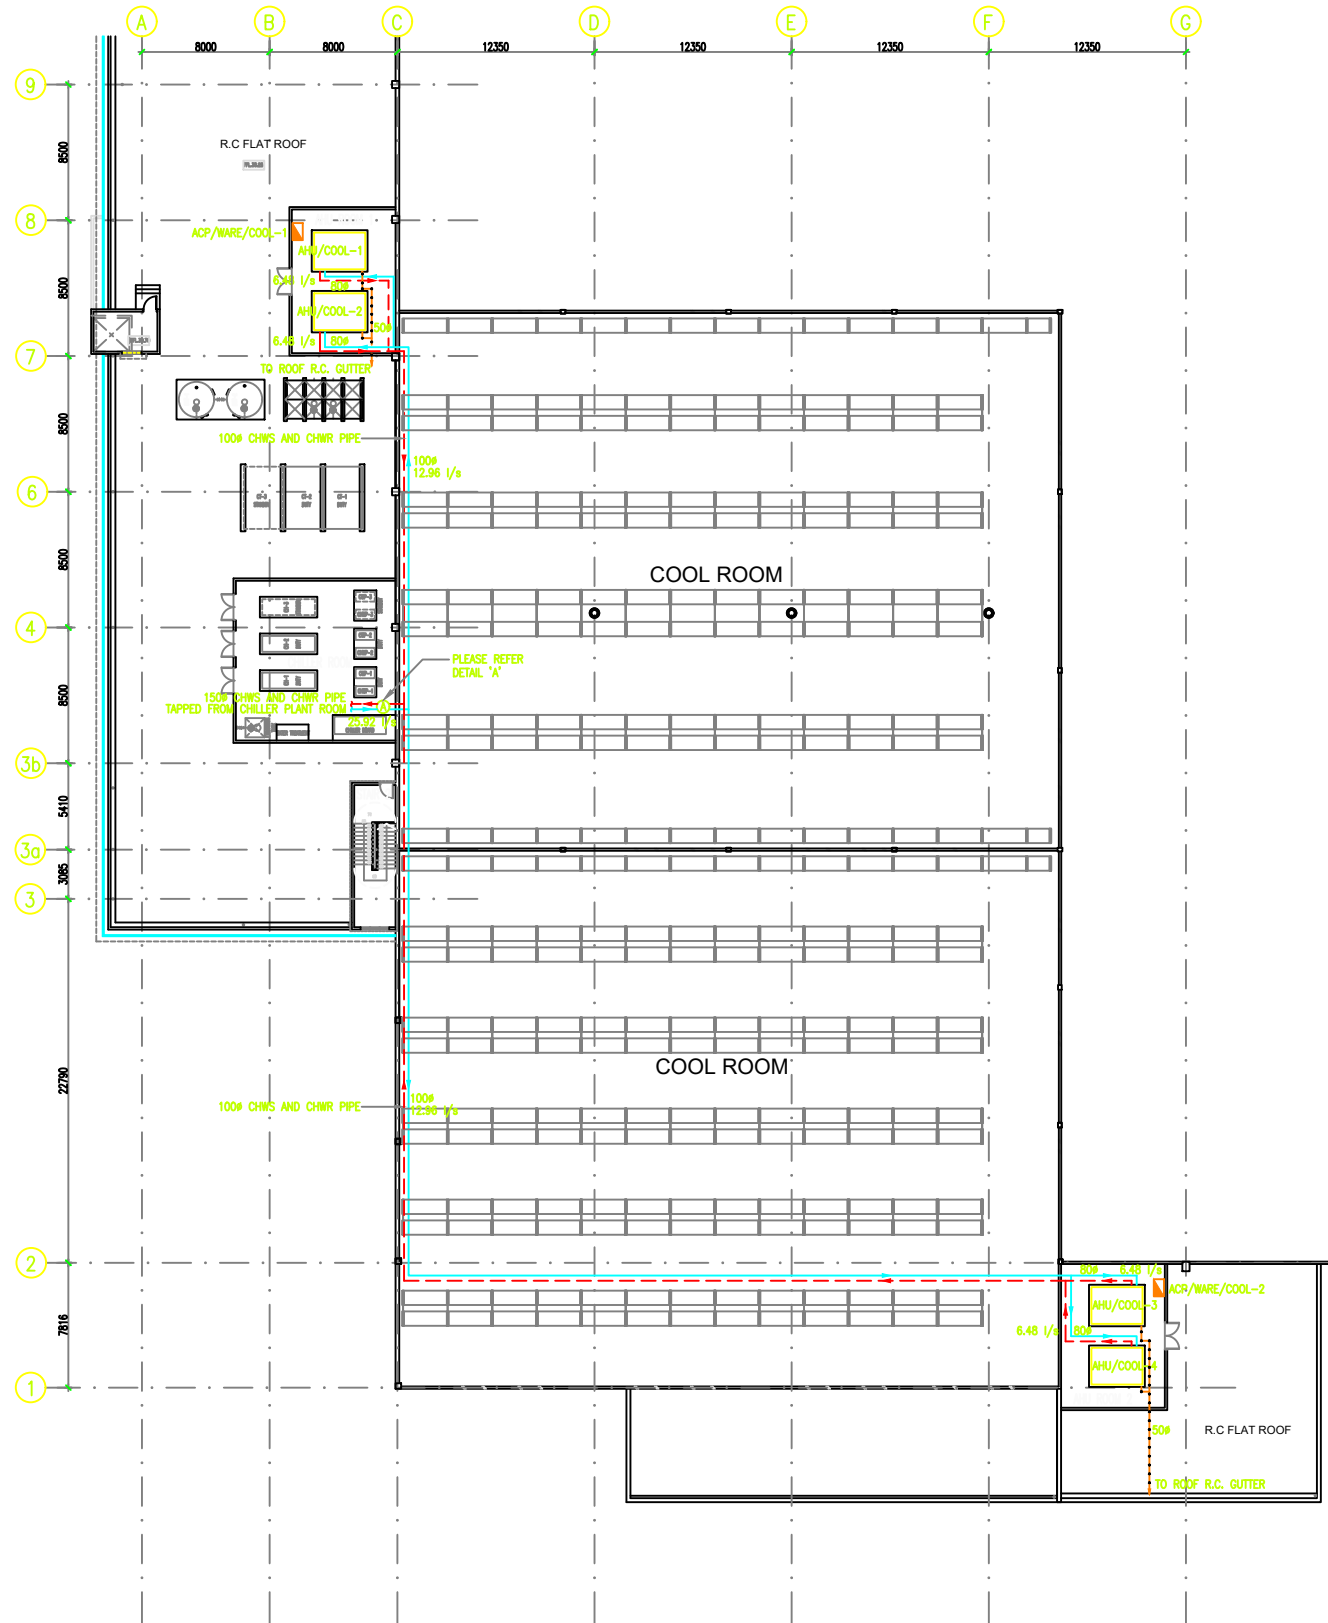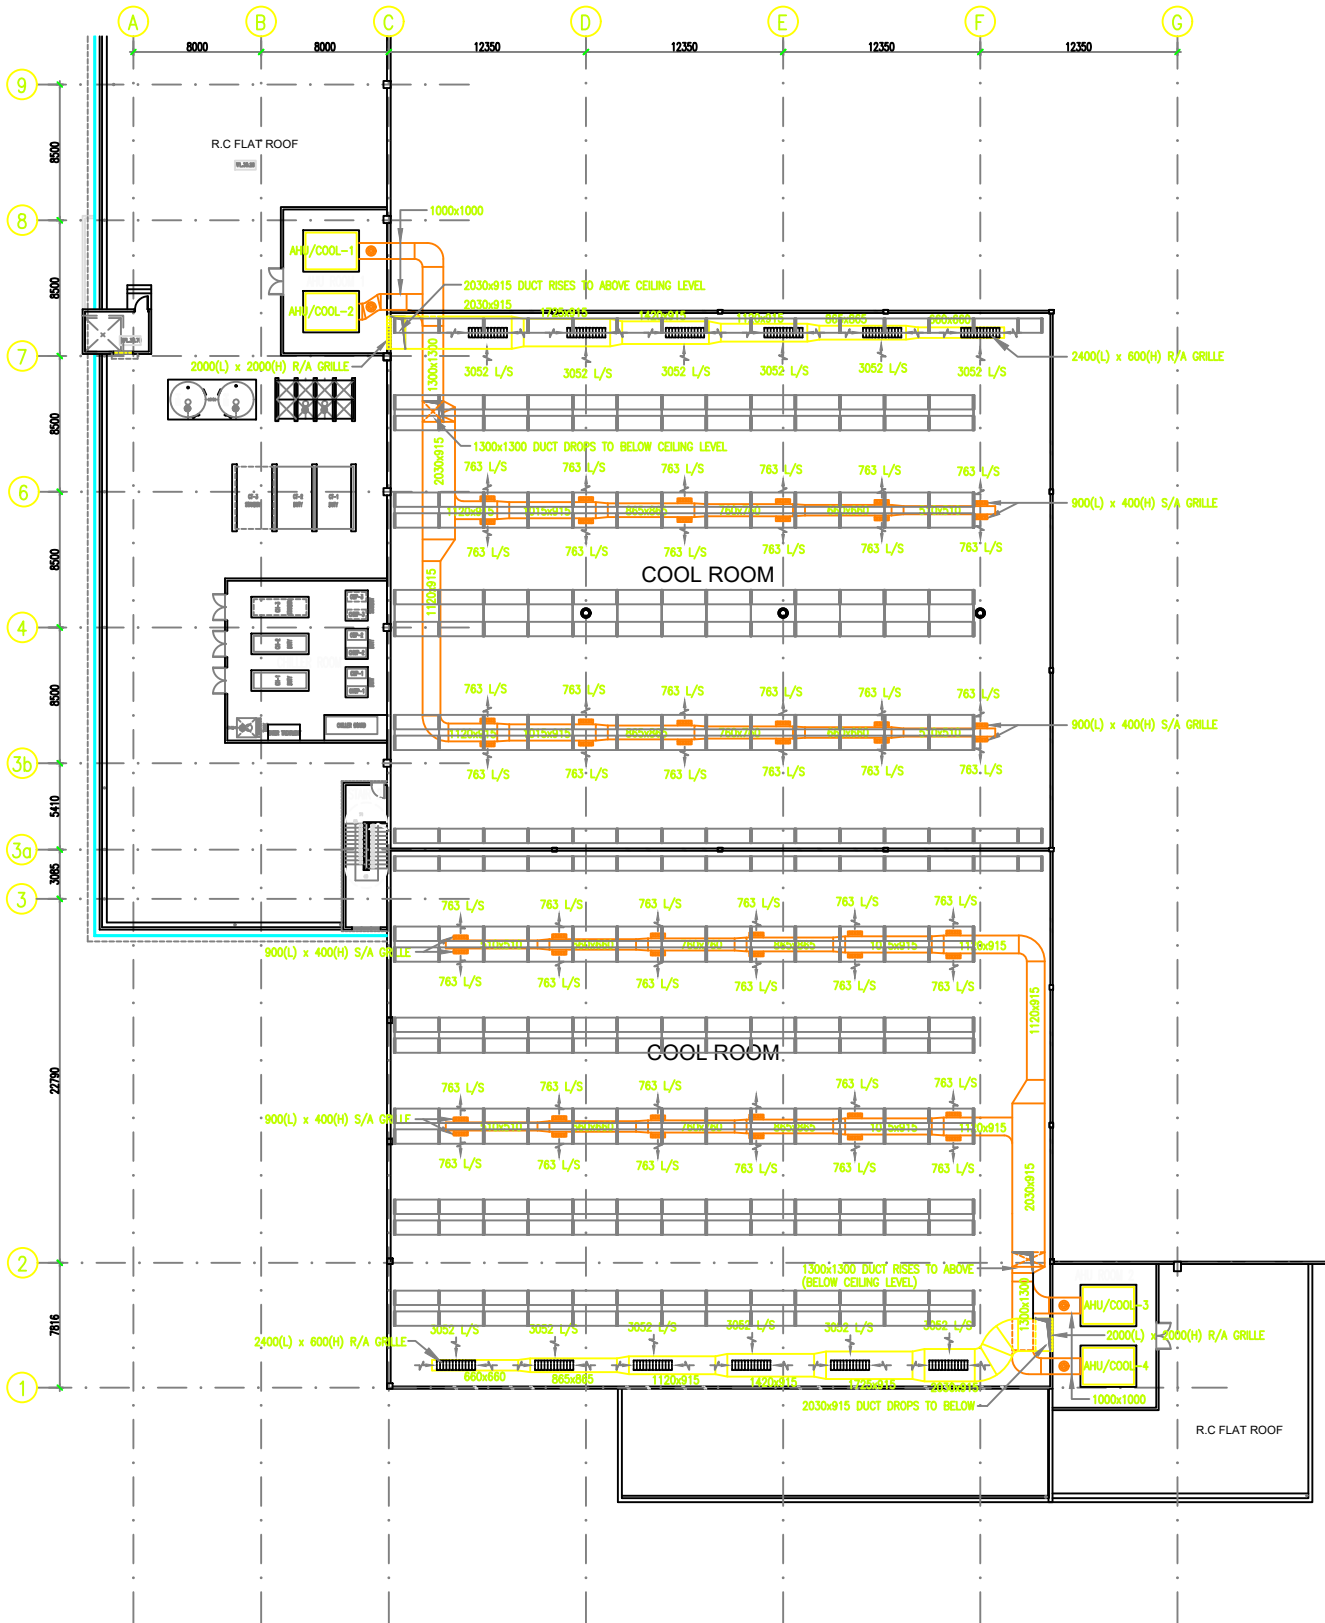

NO.	TARIKH	REVISION	SKS
1	06.05.08	FCU FOR COOL ROOMS REPLACED WITH AHU	SKS
2	24.03.08	ISSUED FOR CONSTRUCTION	SKS
3			OLEH

TAJUK PROJEK :

CADANGAN MEMBINA SEBUAH GUDANG
1 TINGKAT BESERTA PEJABAT 3 TINGKAT,
YANG MENDUNGI:-
PENCAWANG ELEKTRIK TNB,
PUSAT PENGUMPULAN SAMPAH,
BILIK PAM,
1 UNIT PONDOK PENGAWAL DAN
1 UNIT RUANG MENUNGGU 1 TINGKAT,
DI ALAMAT NO.9 (PT 33271)
JALAN TIANG U8/92,
SEKSYEN U8,
PERINDUSTRIAN BUKIT JELUTONG,
40150 SHAH ALAM,
SELANGOR DARUL EHSAN

UNTUK
TETUAN ORYX IMPRESSIONS SDN. BHD.

TANDATANGAN & ALAMAT PEMILIK :

ORYX IMPRESSIONS SDN. BHD. (No. 948894-9)
36-2, JALAN S/101C, OFF. JALAN KASKAS,
JALAN CHERAS, 56100 KUALA LUMPUR,
TEL: 03- 9132 3018 FAX: 03-9132 7018

ARKITEK :

GRA ARCHITECTS
6-15-01, Tower 2, Menara PNB, no. 688 Jalan Pda Ulu, 50100 Kuala Lumpur, Malaysia
Tel: 03-9281 7177 Fax: 03-9287 8258 gnam@gra.com.my

JURUTERA M&E :

PERUNDINGAT02
Jabatan Perunding - Consulting Engineer
238, JALAN SS15/4C, 47500 SUBANG JAYA, SELANGOR DARUL EHSAN
Tel: 03-56369711 Fax: 03-56369777 E-mail: perunding_02@myjaring.net

TAJUK LUKISAN :

WAREHOUSE - COOL ROOM
GROUND FLOOR PLAN

AIR-CONDITIONING AND VENTILATION SYSTEM

DILUKIS	DAN	DISEMAK	SKS
SKALA	1 : 250	TARIKH	MARCH 2008
NO. LUKISAN	508307/M/AC/05	PINDAAN	1

PELAN INI MENDUNGI HAK CIPTA
kontraktor hendaklah mengikut dimensi yang ada di dalam rajah, segala
dimensi mesti diperiksa dan disemak di tapak binaan, sebarang sefahan
yang terdapat hendaklah dipaparkan kepada abitek/jurutera yang berkuasa.